



**PLAN 1:100**  
 (SHOWING UNDERDRAIN I.L.'S - Nos 1-18)  
 150 THICK SLAB GENERALLY

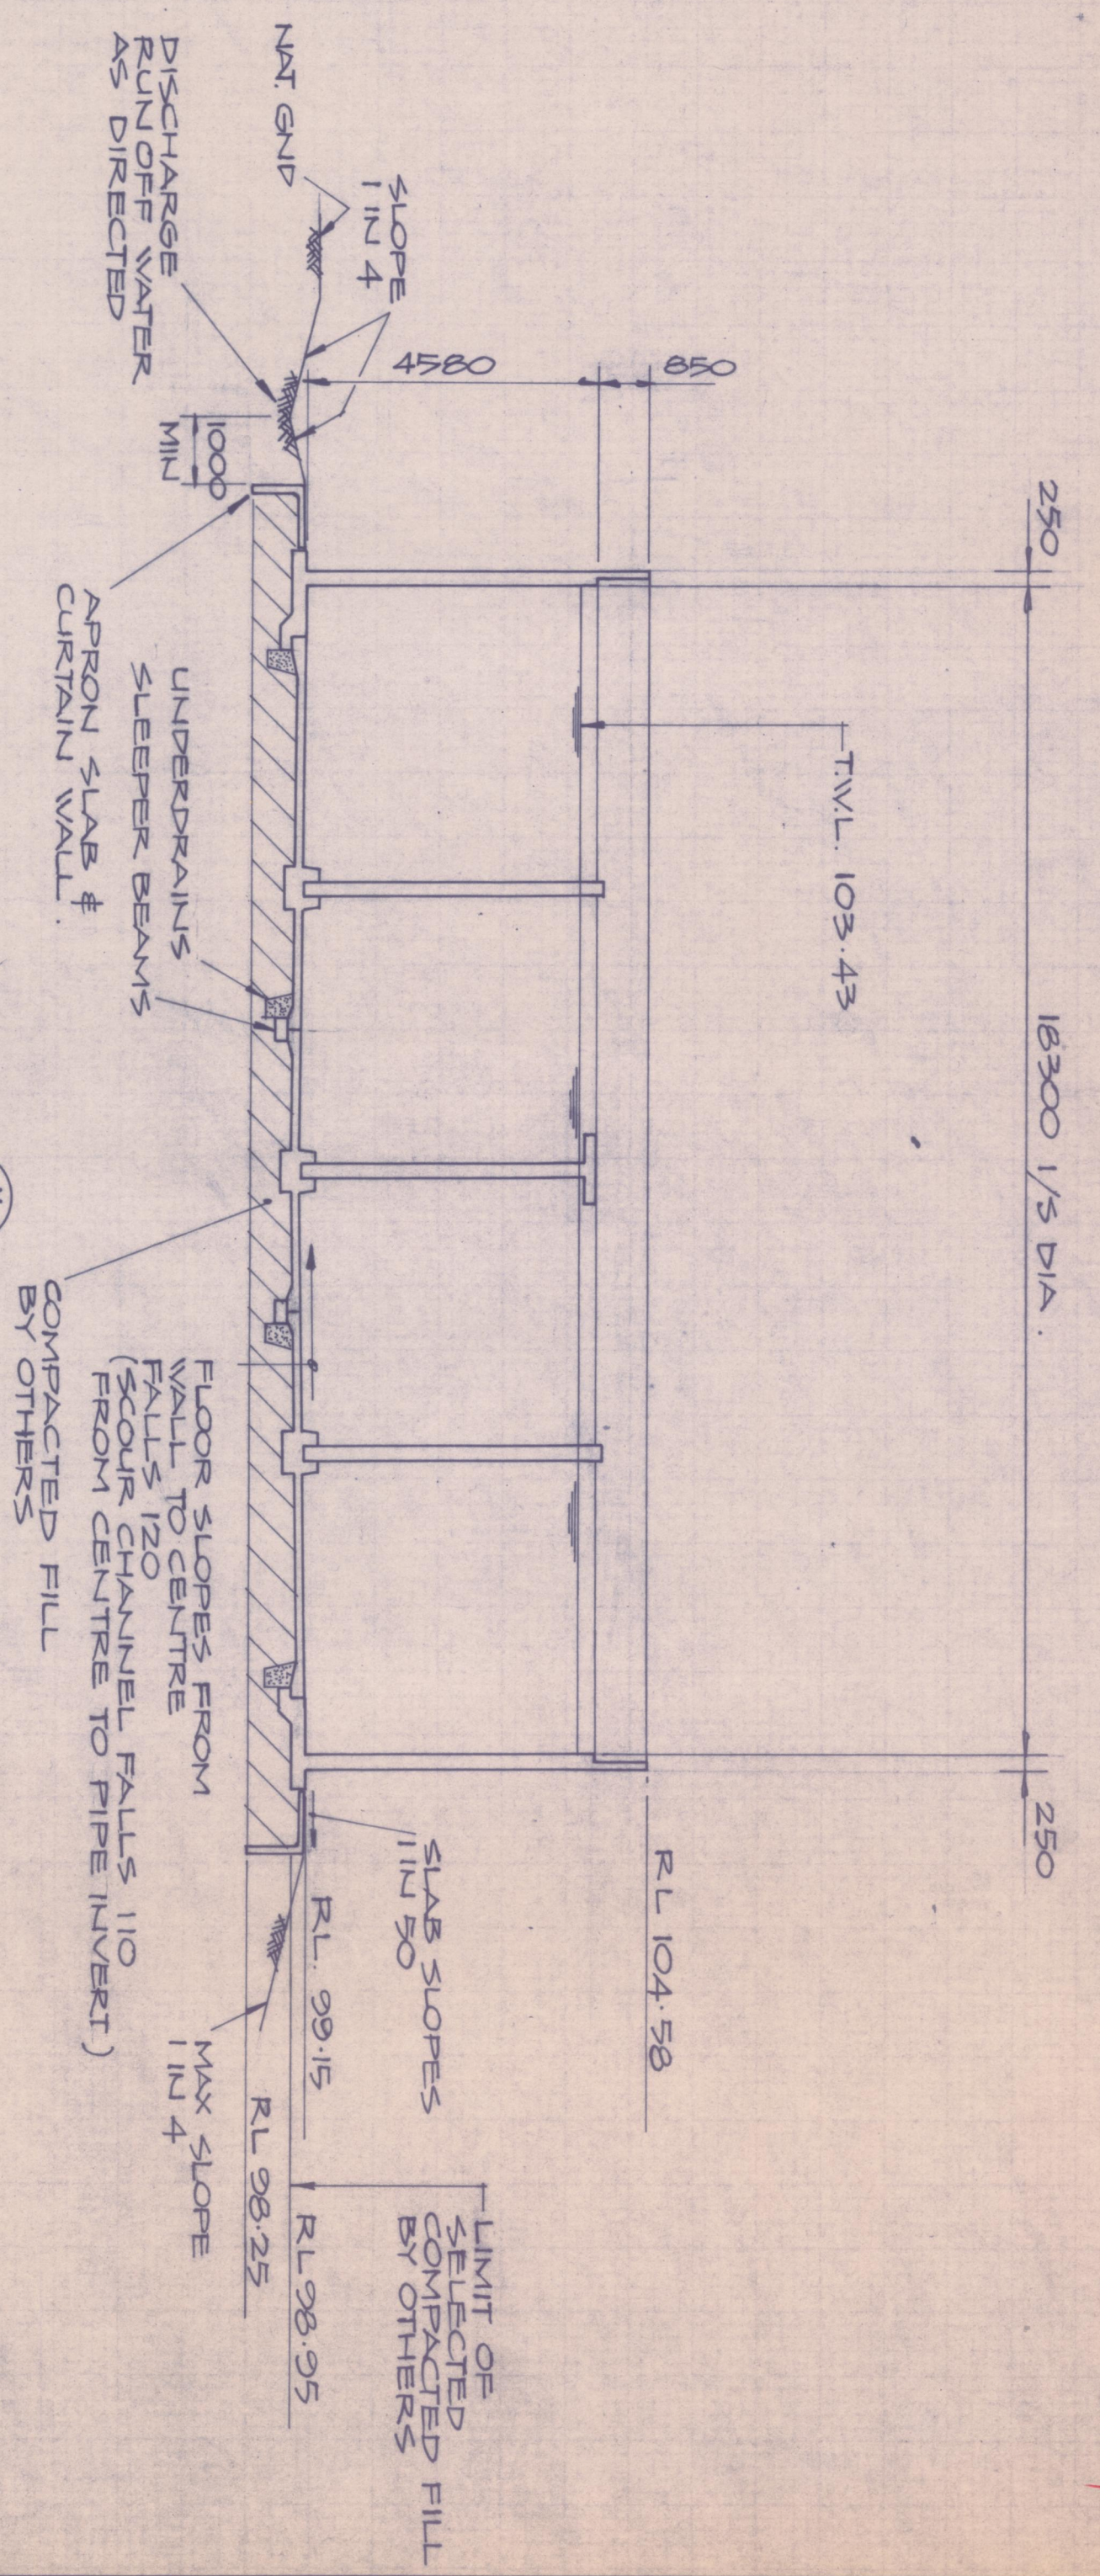

**SECTION X-X 1:100**  
 TAROOM RESERVOIR

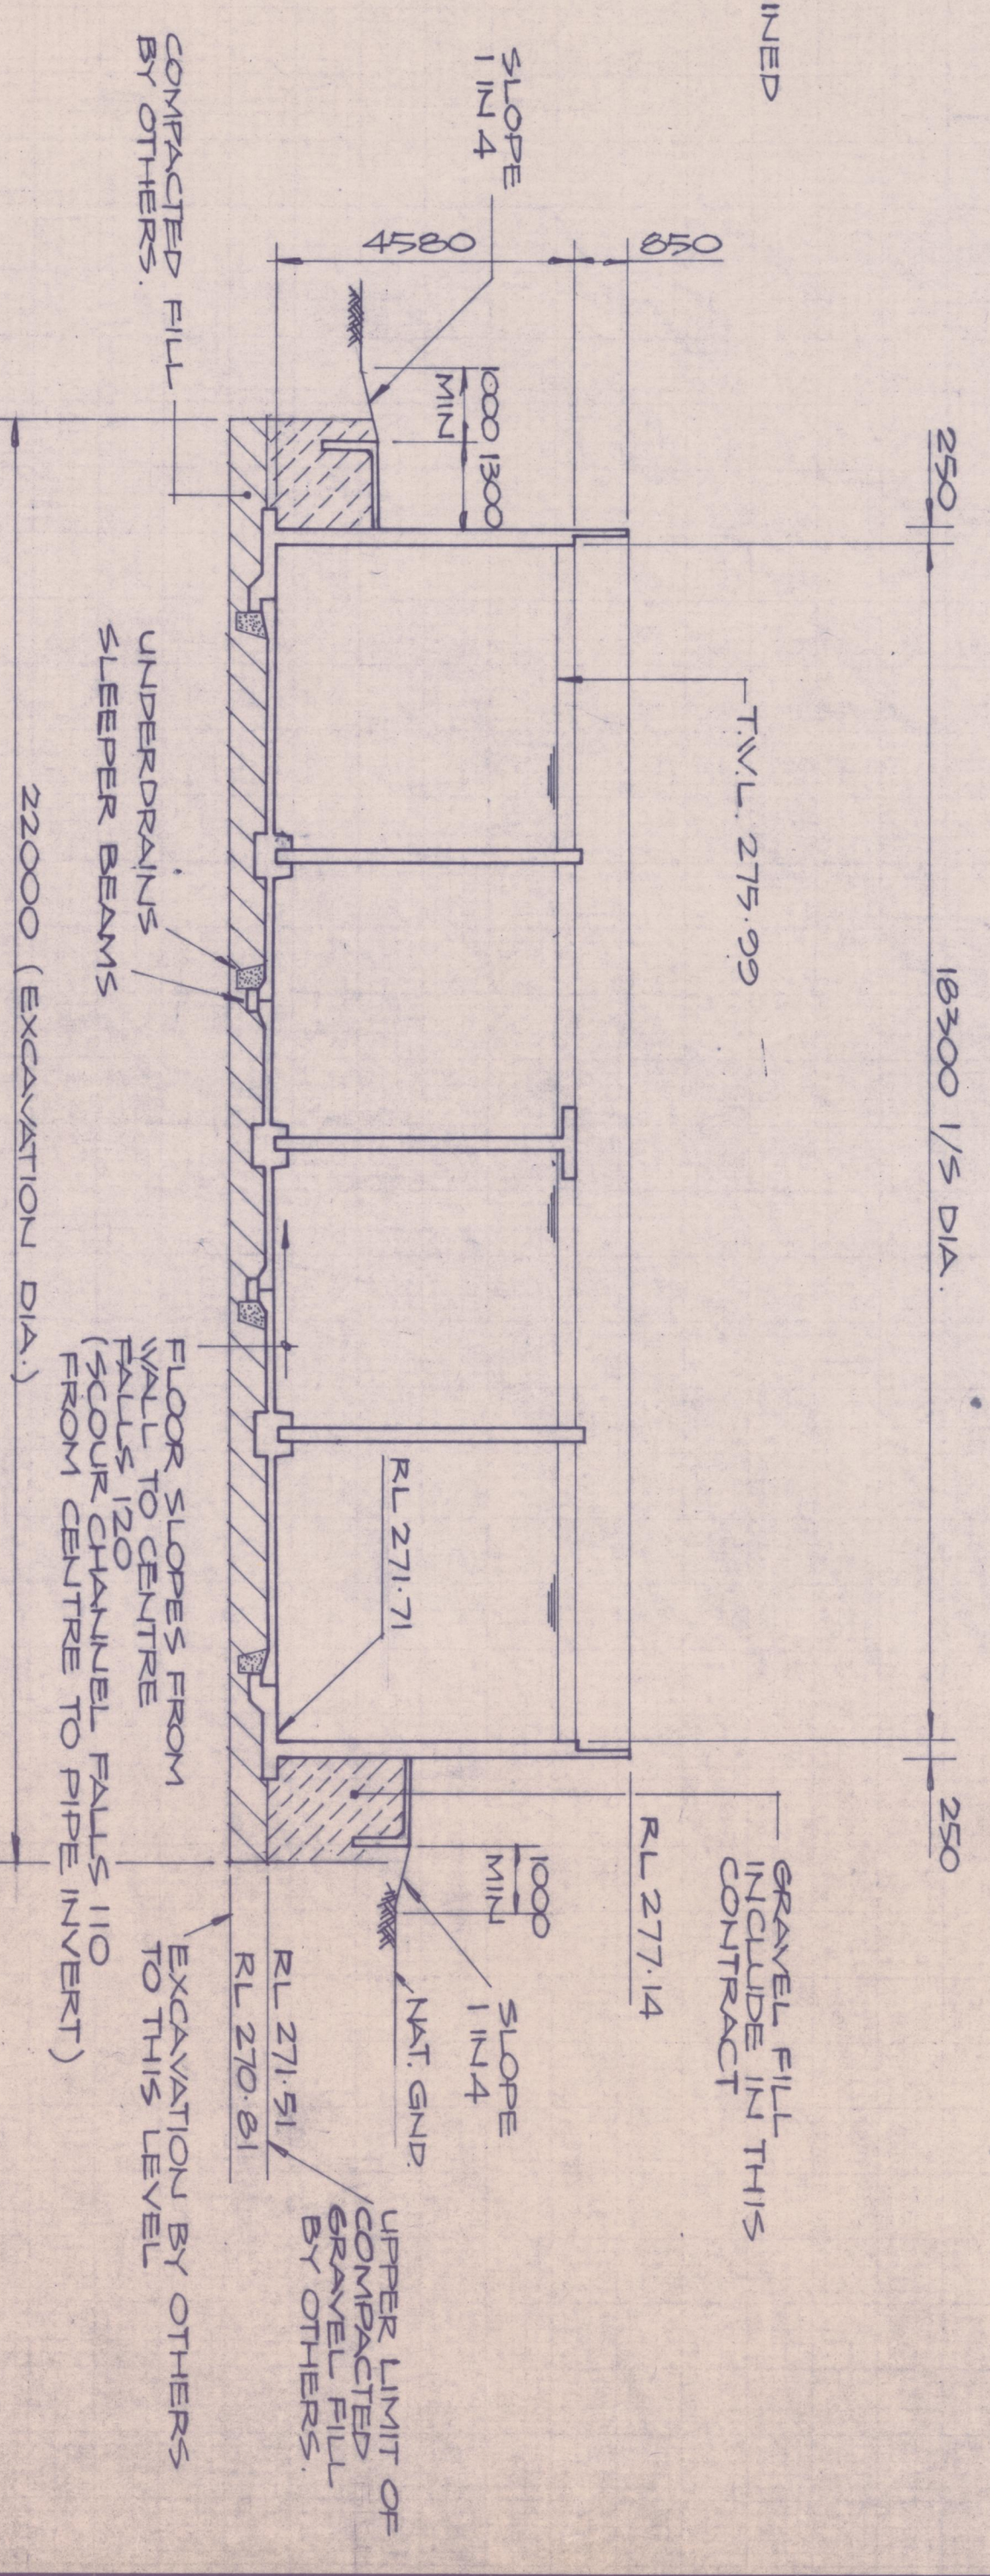

**SECTION X-X 1:100**  
 WANDAN RESERVOIR

- NOTES.**
1. UNDERDRAIN AT JOE OF RING BEAM TO UNDERDRAIN AT JOE OF INTERNAL UNDERDRAINS AT JOE OF INTERNAL POINTS (SIX) EXCEPTING AT SCOUR / OVERFLOW PIT END.
  2. .... CONTRACTION JOINTS (C.J.)

**UNDERDRAIN SCHEDULE**

PLAN LOCATION	I.L. TAROOM	I.L. WANDAN
1,3	98.58	271.14
2	98.59	271.15
4,8	98.54	271.10
5,7,9,13	98.51	271.07
6	98.52	271.08
10,12	98.48	271.04
11	98.49	271.05
14,16	98.45	271.01
15	98.43	270.99
17,18	98.46	271.02

- CONCRETE.**
1. ALL CONCRETE 32 MPa / 20 EXCEPT APRONS CURTAIN WALLS & PIPE SURROUNDS - 20 MPa. BLINDING CONCRETE - 15 MPa.
  2. BAR LAPS 30 BAR DIA. UNO.
  3. COVERS WATER & EARTH - 60mm AIR FACE - 30mm

- GENERAL NOTES.**
1. ANY DISCREPANCIES NOTED IN THE PLANS SHALL BE REFERRED TO THE ENGINEER BEFORE CONSTRUCTION.
  2. DRAWINGS NOT TO BE SCALED.
  3. ALL EXPOSED STEELWORK HOT DIPPED GALVANISED.
  4. ALL BOLTS TO BE STAINLESS STEEL.

Revisions	Issue Date
A	6/90

**G J Brandon & Associates Pty Ltd**  
 CONSULTING ENGINEERS  
 CHINCHILLA ROMA

**TAROOM SHIRE COUNCIL**  
 CLEAR WATER STORAGE AUGMENTATION  
**GENERAL ARRANGEMENT**  
**8 FLOOR PLAN**

Drawn: JW	Scale: FULL SIZE A1	Job No.: 90-229
Designed: BAP	1:100	No. 3 of 7 Plans
Checked: JL		Plan No.: 9022903
Approved: [Signature]		